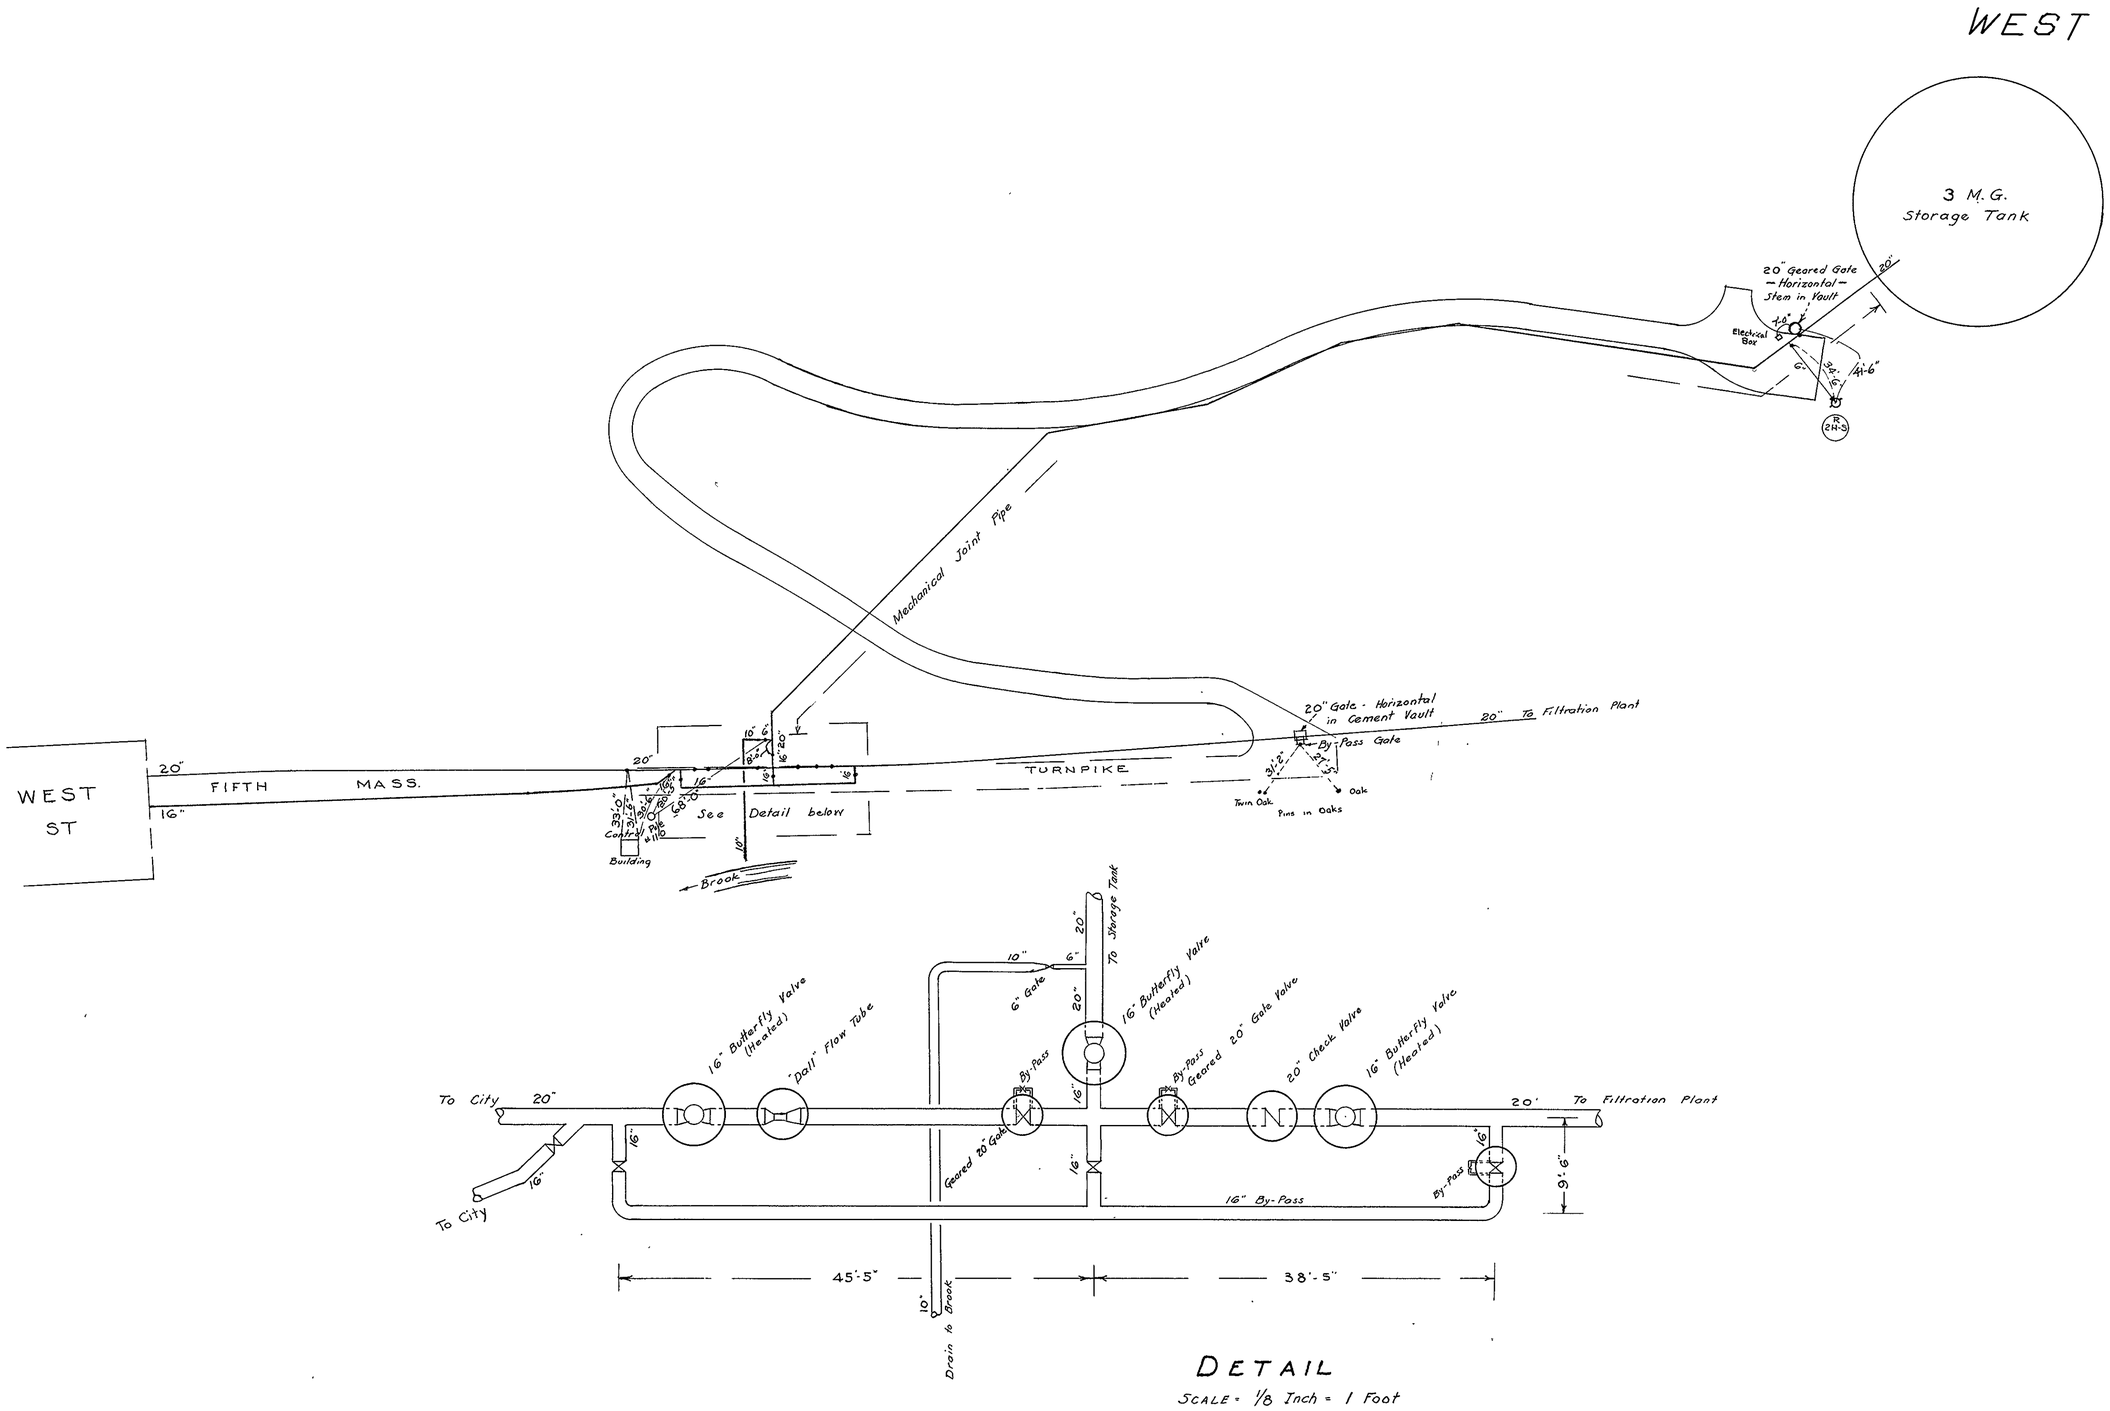
WEST ST.
3 M.G.
Storage Tank
20" Geared Gate
Horizontal
Stem in Vault
Electrical Box
Mechanical Joint Pipe
20" Gate - Horizontal
in Cement Vault
By-Pass Gate
20" To Filtration Plant
WEST
ST
FIFTH
MASS.
TURNPIKE
See Detail below
Control Bldg
Building
Brook
Twin Oak
Pine in Oaks
Oak
To Storage Tank
16" Butterfly Valve
(Heated)
"Doll" Flow Tube
6" Gate
By-Pass
Geared 20" Gate
By-Pass
Geared 20" Gate Valve
20" Check Valve
16" Butterfly Valve
(Heated)
To City
To City
To Filtration Plant
16" By-Pass
45'-5"
38'-5"
Drain to Brook
DETAIL
SCALE = 1/8 Inch = 1 Foot
Control
B'ld'g

217-B