

*City of Leominster, Department of Public Works, Water Division
Public Water Supply ID # 2153000*

2018 DRINKING WATER QUALITY REPORT

The City of Leominster is dedicated to preserving and improving the quality and reliability of its drinking water supplies. In addition to continued source protection efforts and significant upgrades to all of its treatment facilities, the City has an aggressive flushing and water main replacement program. Further information about this report or any aspect of the public water supply can be obtained by contacting Mark Piermarini at 978-534-7590, ext. 3639, cell phone 978-660-0061, or e-mail: Mpiermarini@dpw.leominster-ma.gov

YOUR DRINKING WATER SOURCES

The City of Leominster lies entirely within the Nashua River basin. It encompasses about 30 square miles of land. Much of the western half of the city includes state forest, watershed lands, and other protected open space. The City obtains its drinking water from the Distributing Reservoir system, including Haynes and Morse Reservoirs; the Fallbrook Reservoir at Wachusett Street; the Notown Reservoir system, including Goodfellow Pond and Simonds Reservoirs; and the Southeast Corner Well Fields at Jungle Road. Leominster also has an emergency connection to the Wachusett Reservoir.

SOURCE WATER ASSESSMENT AND PROTECTION

In 2004 the Massachusetts Department of Environmental Protection (MassDEP) completed a Source Water Assessment and Protection (SWAP) report for the sources serving this water system. MassDEP assigned an overall susceptibility ranking of *high* to Leominster's water sources, based on the presence of at least one high threat land use within the water supply protection areas. The City of Leominster continues to actively promote source protection through aggressive land acquisition, installation of sanitary sewers, and continued public education efforts

Where can I see the SWAP Report?

The SWAP report and map are available at the Leominster Water Division. The report can also be viewed online at <https://www.mass.gov/lists/source-water-assessment-and-protection-swap-program-documents> under the Central Region: Source Water Assessment & Protection (SWAP) Program, bookmark 2153000.

EDUCATIONAL INFORMATION

In order to ensure that tap water is safe to drink, the U.S. Environmental Protection Agency (EPA) and MassDEP prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. Food and Drug Administration (FDA) and Massachusetts Department of Public Health regulations establish limits for contaminants in bottled water that must provide the same protection for public health. All drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants do not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the EPA Safe Drinking Water Hotline at 800-426-4791.

Sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring mineral, and in some cases, radioactive material. It can pick up substances resulting from the presence of animals or from human activity.

Contaminants that may be present in source water include:

Microbial contaminants -such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.

Inorganic contaminants -such as salts and metals, which can be naturally-occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.

Pesticides and herbicides -which may come from a variety of sources such as agricultural, urban storm water runoff, and residential uses.

Organic chemical contaminants -including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban storm water runoff, and septic systems.

Radioactive contaminants -which can be naturally occurring or be the result of oil and gas production and mining activities.

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and some infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/Centers for Disease Control guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* are available from the Safe Drinking Water Hotline at 800-426-4791.

Lead - If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with home plumbing. The Leominster Water Division is responsible for providing high-quality drinking water, but cannot control the variety of materials used in plumbing and plumbing components. When your water is unused for several hours, you can minimize the potential for lead exposure by running your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at www.epa.gov/safewater/lead. Please feel free to call Mark Piermarini at 978-534-7590 ext. 3639, cell phone 978-660-0061, or email at Mpiermarini@dpw.leominster-ma.gov.

HAA5s - We are required to monitor the drinking water for Haloacetic Acids (HAA5) levels, which are by-products of drinking water chlorination, on a quarterly basis at four specific locations in the distribution system. The results of the sampling, which was performed on October 24, 2018 showed that our system exceeded the standard or maximum contaminant level (MCL) for HAA5 at two out of four locations. The standard for HAA5s is 60 parts per billion (ppb) and compliance is determined on a quarterly basis by averaging all samples collected at each location for the last 12 months (Locational Running Annual Average). This was not an immediate risk. If it had been, you would have been notified right away. However, pregnant women, infants and women of childbearing age may be at increased risk and should seek advice from their health care providers if they have any concerns. Some people who drink water containing (HAA5s) haloacetic acids in excess of the MCL over many years may have an increased risk of getting cancer. **Testing in the first quarter of 2019 shows our system is presently in compliance with the HAA5 MCL.**

WATER SYSTEM IMPROVEMENTS

In July and October of 2018 The City of Leominster Notown Reservoir water system exceeded the EPA Locational Running Annual Average (LRAA) MCL for Haloacetic Acids (HAA5s). The Leominster Water Division implemented a short term resolution which reduced the level of disinfection byproducts to acceptable levels and we are continuing to look at long term solutions, to improve the Notown Plant Water Treatment Plant in an ongoing effort to control disinfection byproducts and improve the overall quality of the water.

In 2015 and 2016 the media was changed in all the plants' filters and a new air scouring system was installed. In the last ten years Leominster Water Division has built a new plant at Distributing Reservoir, rebuilt and added pre – filter clarification at the Notown Plant, solved a seasonal raw water manganese problem at Fallbrook reservoir, built a new facility for chlorine injection and corrosion control at Southeast Wells and re-built the Pond Street Pump Station. We continue to inspect and improve our storage tanks, reservoir dams and intakes, and pump stations.

On the distribution system, a total of 6,650 linear feet of new water mains were added in 2018 on Highland Avenue, Lindell Avenue, Merriam Avenue, Beacon Street, Fairmount Street, Tisdale Avenue, James Court and White Pond Road. A semiannual water main flushing program has greatly reduced rusty water complaints. We are continuously upgrading our meter reading system. A total of 49 hydrants were repaired or replaced with new hydrants. This type of water system work will continue each year.

To help us provide the highest quality water available to our customers, the Water Division has an ongoing operator training program that encourages staff to achieve the highest qualifications in the field as possible. In addition, the reservoirs and wells are policed by a reservoir guard to prevent vandalism and potential contamination of drinking water. A forestry management program has begun to harvest mature trees and cleanup ice storm damage in an effort to manage the watershed properly and prevent forest fires.

IMPORTANT DEFINITIONS

Maximum Contaminant Level (MCL) – the highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available technology.

Maximum Contaminant Level Goal (MCLG) – the level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Treatment Technique (TT) – A required process intended to reduce the level of a contaminant in drinking water.

Action Level (AL) – The concentration of a contaminant, which, if exceeded, triggers treatment or other requirements, which a water system must follow.

Running Annual Average (RAA) – The average of four consecutive quarters of data.

Range: This column shows the lowest and highest values found in our tests.

90th Percentile: Lead and copper compliance is based on the 90th percentile value, which is the highest level found in 9 out of every 10 homes sampled. This number is compared to the action level for each contaminant

Unregulated Contaminants: Unregulated contaminants are substances without MCLs for which EPA requires monitoring. For some of these substances, the Massachusetts Office of Research and Standards (ORS) has developed state guidelines or secondary MCLs.

Secondary Maximum Contaminant Level (SMCL): These standards are developed to protect the aesthetic qualities of drinking water and are not health based.

Office of Research and Standards Guideline (ORSG): This is the concentration of a chemical in drinking water, at or below which, adverse health effects are unlikely to occur after chronic (lifetime) exposure. If exceeded, it serves as an indicator of the potential need for further action.

Maximum Residual Disinfectant Level (MRDL): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum Residual Disinfectant Level Goal (MRDLG) -- The level of a drinking water disinfectant below which there is no known expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

ppm = parts per million, or milligrams per liter (mg/l)

ppb = parts per billion, or micrograms per liter (µg/l)

pCi/l = picocuries per liter (a measure of radioactivity)

NTU = nephelometric turbidity units

WATER QUALITY TESTING RESULTS

The following test results were from monitoring performed during 2018 or during the most recent sampling period for each contaminant group, as required by MassDEP. Only detected contaminants in finished water are shown.

Lead and Copper	Date Collected	90th Percentile	Action Level (AL)	MCLG	# of sites sampled	# of sites above AL	Exceeds AL (Y/N)	Possible Sources
Lead (ppb)	2017	3	15	0	30	0	N	Corrosion of household plumbing
Copper (ppm)	2017	0.43	1.3	1.3	30	0	N	Corrosion of household plumbing

Regulated Contaminants	Date(s) Collected	Highest Result or Highest RAA	Range Detected	MCL or MRDL	MCLG or MRDLG	Violation (Y/N)	Possible Sources
Inorganic Contaminants							
Nitrate (ppm)*	4/11/2018	0.17	0 - 0.17	10	10	N	Runoff from fertilizer use; leaching from septic tanks; natural deposits
Perchlorate (ppb)	7/11/2018	0.40	0.07 – 0.40	2	---	N	Fireworks, firearms, blasting materials
Barium (ppm)	4/11/2018	0.012	0.007 – 0.012	2	2	N	Erosion of natural deposits
Synthetic Organic Contaminants							
Atrazine (ppb)*	1/5/2016 7/12/2016	0.23	0.15 – 0.23	3	3	N	Runoff from herbicide used on row crops
Disinfection Contaminants							
Haloacetic Acids (HAA5s) (ppb)	Quarterly	68**	11 - 88	60	--	Y	Byproduct of drinking water disinfection
Total Trihalomethanes (TTHMs) (ppb)	Quarterly	80**	31 - 112	80	--	N	Byproduct of water chlorination
Chlorine (ppm)	60 -75 samples per month	1.63	0.03 – 1.63	4.0	4	N	Water additive used to control microbes
Radioactive Contaminants							
Combined Radium (pCi/L)	4/7/2015	1.1	0 – 1.1	5	0	N	Erosion of natural deposits
Gross Alpha (pCi/L)	4/7/2015	2.2	0 - 2.2	15	0	N	Erosion of natural deposits

* Found only at the Southeast Wells.

** Location Running Annual Average (LRAA) is the highest average of four consecutive quarters.

Unregulated and Secondary Contaminants	Date Collected	Range	Average	SMCL	ORSG or Health Advisory	Possible Sources
Manganese (ppb)*	4/11/2018	6 - 20	10	50	300	Naturally Occurring
Iron(ppb)	4/11/2018	0 - 260	73	300		Naturally Occurring
Sodium (ppm)**	4/11/2018	13 – 28	19	--	20	Natural sources; runoff from road salt

* EPA and MassDEP have established a health advisory of 300 ppb for manganese to protect against potential neurological effects.

** Sodium-sensitive individuals, such as those experiencing hypertension, kidney failure, or congestive heart failure, should be aware of sodium levels in their drinking water where exposures are being carefully controlled.

Turbidity is a measure of the cloudiness of the water. We monitor it because it is a good indicator of water quality.

Distributing Water Treatment Facility (Filtered)	MCL	Lowest Monthly % of Samples	Highest Detected Daily Value	Violation (Y/N)	Possible Source of Contamination
Turbidity (NTU)	1	----	0.55	N	Soil runoff
Monthly Compliance*	At least 95% < 0.3 NTU	99.86	----	N	
Notown Water Treatment Facility (Filtered)	TT	Lowest Monthly % of Samples	Highest Detected Daily Value	Violation (Y/N)	Possible Source of Contamination
Daily Turbidity Compliance (NTU)	1	-----	0.46	N	Soil runoff
Monthly Compliance*	At least 95% < 0.3 NTU	99.69	----	N	
Fallbrook Water Treatment Facility (Filtered)	TT	Lowest Monthly % of Samples	Highest Detected Daily Value	Violation (Y/N)	Possible Source of Contamination
Daily Turbidity Compliance (NTU)	1	-----	0.33	N	Soil runoff
Monthly Compliance*	At least 95% < 0.3 NTU	99.87	----	N	

*Monthly turbidity compliance is related to a specific treatment technique (TT). This treatment facility filters the water so at least 95% of our samples each month must be below the turbidity limits specified in the regulations.

CROSS CONNECTION INFORMATION FOR RESIDENTIAL CUSTOMERS


As users of a shared valuable resource, we should all be aware of the potential for drinking water contamination by cross connection. A cross connection occurs whenever a pipe or hose is placed in any container or machine, such as a hose placed in a pool or a pipe feeding a lawn sprinkler system.

When there is a reverse flow, caused by a water main break or other sudden loss of pressure, the drinking water pipes may get contaminated with whatever the line was feeding – such as pool water, fertilizers, or pesticides. This can be avoided by installing the proper backflow prevention device for a given application or maintaining an air gap between the outlet and the container being filled.

Hose Bib Vacuum Breakers are simple, low-cost devices that should be used to help prevent backflow of water when using water hoses. They are easy to install and available at many plumbing supply stores.



hose bib vacuum breaker

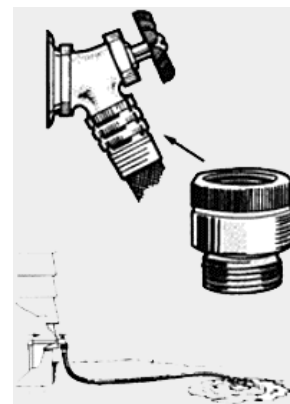

For more info, call Mark Piermarini at 978-534-7590, extension # 3639.

City of Leominster
 Water Division
 109 Graham Street
 Leominster, MA 01453

PUBLIC PARTICIPATION

The Leominster Water Division recognizes that it exists to meet the needs of its customers and welcomes comments from any person it serves. Please feel free to call at 978-534-7590, ext. 518, cell phone 978-660-0061 email – Mpiermarini@dpw.Leominster-MA.gov. For customers wishing to be more involved in the affairs of the Leominster Water Division, the public is welcome to attend meetings of the Leominster City Council's Public Services Committee, which oversees Water Division operations. To find out when the committee is meeting, please contact Claire Freda at CFreda@leominster-ma.gov or call 978-537-4686. Information about the Water Division is also posted on the City's website at www.leominster-ma.gov/dpw_department_water.htm

El informe contiene información importante sobre la calidad del agua en su comunidad. Tradúzcalo o hable con alguien que lo entienda bien.

Le rapport contient des informations concernant la qualité de l'eau de votre communauté. Faites-le traduire, ou parlez-en à un ami qui le comprend bien.